



## Designated according to The Construction Products (Amendment etc.) (EU Exit) Regulations 2020 (as amended 2022)

<b>UK Technical Assessment</b>	<b>UKTA-0836-23/6693 of 21/07/2023</b>
Technical Assessment Body issuing the UK Technical Assessment:	British Board of Agrément
Trade name of the construction product:	Injection system Hilti HIT-HY 270
Product family to which the construction product belongs:	Injection system for use in masonry
Manufacturer:	Hilti AG Feldkircherstraße 100 9494 Schaan Principality of Liechtenstein
Manufacturing plant(s):	Hilti Plants
This UK Technical Assessment contains:	51 pages including 3 Annexes which form an integral part of this assessment.
This UK Technical Assessment is issued in accordance with The Construction Products (Amendment etc.) (EU Exit) Regulations 2020 (as amended 2022) on the basis of:	UKAD 330076-00-0604 Metal injection anchors for use in masonry

**Communication of this UK Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made with the written consent of the British Board of Agrément. Any partial reproduction must be identified as such.**

### 1. Technical description of the product

The Injection system Hilti HIT-HY 270 for masonry is a bonded anchor (injection type) consisting of a mortar foil pack with injection mortar Hilti HIT-HY 270, a perforated sieve sleeve and an anchor rod with hexagon nut and washer in the range of M6 to M16, or an internal threaded sleeve in the range of M8 to M12. The steel elements are made of zinc-coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond and/or mechanical interlock between steel element, injection mortar and masonry.

The product description is given in Annex A.

### 2. Specification of the intended use(s) in accordance with the applicable UK Assessment Document (hereinafter UKAD)

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this UK Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3. Performance of the product and references to the methods used for its assessment.

#### 3.1. Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for steel elements	See Annex C1
Characteristic resistance for anchors in masonry units	See Annexes C3 – C30
Displacements under shear and tension loads	See Annexes C3 – C30
Reduction Factor for job site tests ( $\beta$ -Factor)	See Annex C1
Edge distances and spacing	See Annexes C2 – C30
Group factor for group fastenings	See Annexes C2 – C30

#### 3.2. Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	No performance assessed.

### **3.3. Health, hygiene and the environment (BWR 3)**

Regarding dangerous substances, there may be requirements (e.g. transposed UK legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this UK Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

### **3.4. Safety and accessibility in use (BWR 4)**

The essential characteristics regarding safety in use are included under Basic Works Requirement 1: Mechanical resistance and stability.

### **3.5. Protection against noise (BWR 5)**

Not relevant.

### **3.6. Energy economy and heat retention (BWR 6)**

Not relevant.

### **3.7. Sustainable use of natural resources (BWR 7)**

No performance assessed.

## **4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied.**

### **4.1. System of assessment and verification of constancy of performance**

According to UKAD No. 330076-00-0604 and Annex V of the Construction Products Regulation (Regulation (EU) 305/2011) as brought into UK law and amended, the system of assessment and verification of constancy of performance (AVCP) 1 applies.

## **5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable UKAD.**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with the British Board of Agrément and made available to the UK Approved Bodies involved in the conformity attestation process.

### **5.1. UKCA marking for the product/ system must contain the following information:**

- Identification number of the Approved Body
- Name/ registered address of the manufacturer of the product/ system
- Marking including date of Marking and the intended use as stated in the Designated technical specification
- Unique identification code of the product type
- The reference number of the Declaration of Performance
- The level or class of the performance declared
- The reference to the Designated technical specification applied
- UKTA number

On behalf of the British Board of Agrément



Date of Issue: 21 July 2023

**Hardy Giesler**  
Chief Executive Officer




**British Board of Agrément,**  
1<sup>st</sup> Floor Building 3,  
Hatters Lane,  
Croxley Park  
Watford  
WD18 8YG

**ANNEX A1**  
**Product description**  
**Installed condition**


This annex applies to the product described in the main body of the UK Technical Assessment.

**Installed condition**


**Figure A1:** Hollow and solid brick with threaded rod, HIT-V... and one sieve sleeve HIT-SC (see Table B5), or with internally threaded sleeve HIT-IC and one sieve sleeve HIT-SC (see Table B7)

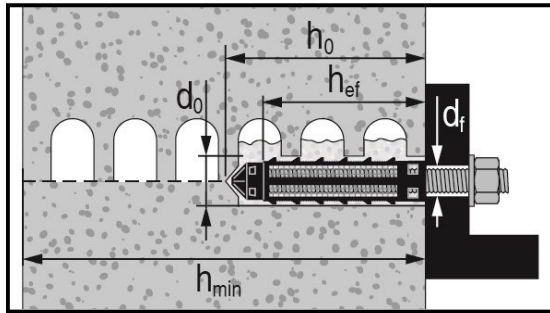

**Figure A2:** Hollow and solid brick with threaded rod, HIT-V... and two sieve sleeves HIT-SC for deeper embedment depth (see Table B6)

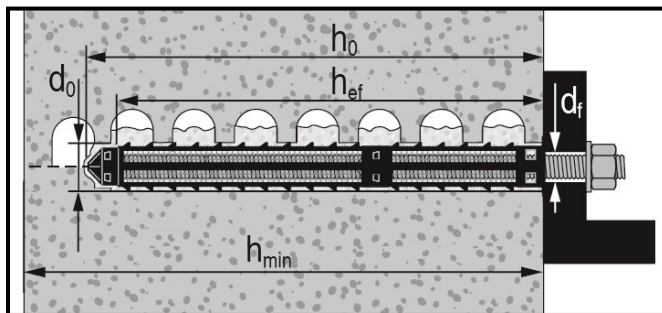


**Figure A3:** Solid brick with threaded rod, HIT-V... (see Table B8)

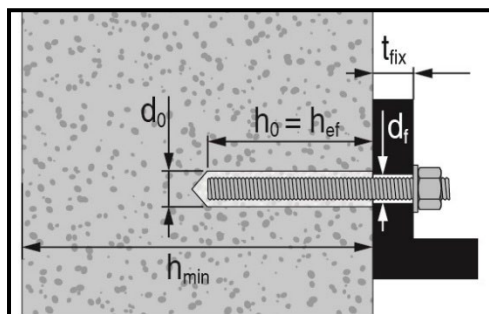


**ANNEX A2**  
**Product description**  
**Installed condition**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Figure A4: Solid brick with internally threaded sleeve HIT-IC (see Table B9)**

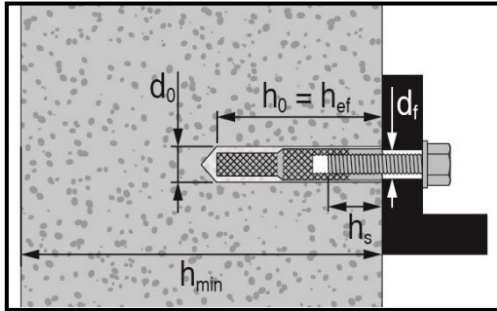

**Figure A5: Hollow and solid brick with threaded rod, HIT-V-... with two sieve sleeves HIT-SC for setting through the fixture and/or through the non-loadbearing layer (see Table B10)**

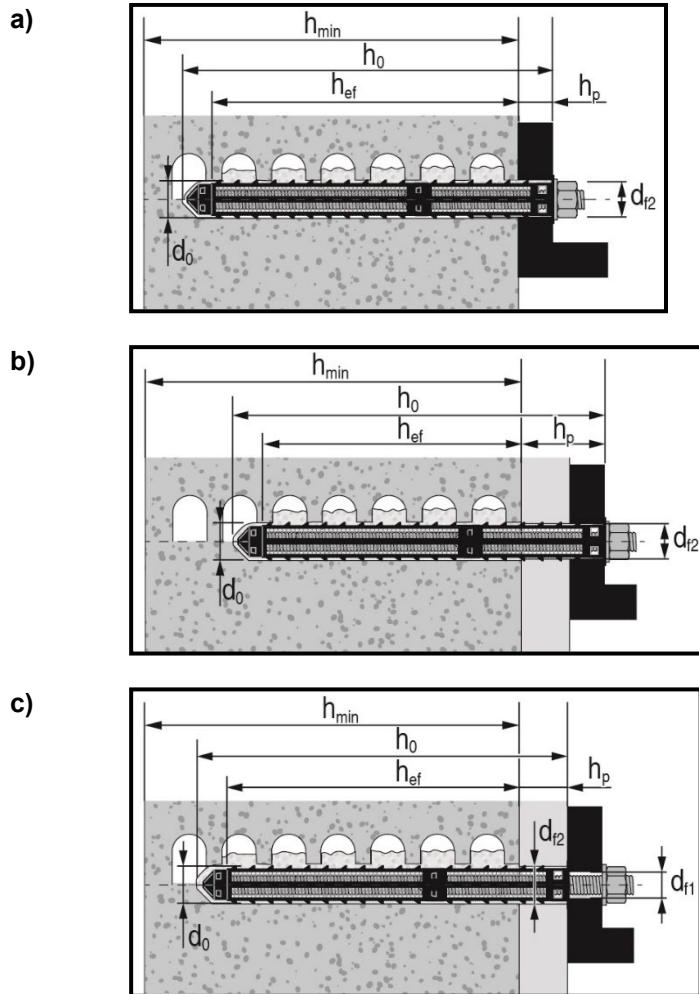

## ANNEX A3

### Product description

Injection mortar / Static mixer / Steel elements / Sieve sleeve

This annex applies to the product described in the main body of the UK Technical Assessment.

### Product description: Injection mortar and steel elements

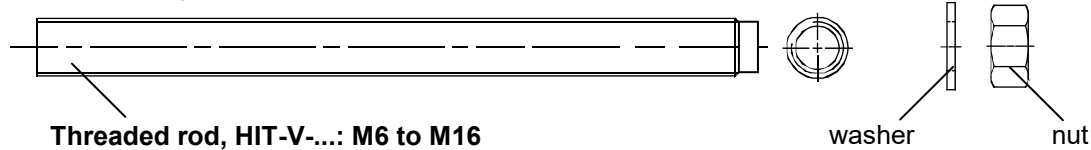
Injection mortar Hilti HIT-HY 270: Hybrid system with aggregate  
330 ml and 500 ml



### Static mixer Hilti HIT-RE-M



### Threaded rod, HIT-V-...



Commercial standard threaded rod with:


- Materials, dimensions and mechanical properties according to Table A1.
- Inspection certificate 3.1 according to EN 10204:2004. The document shall be stored.
- Marking of embedment depth.

### Internally threaded sleeve HIT-IC M8 to M12



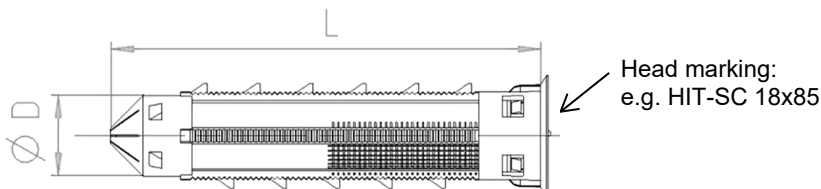Marking:  
e.g. HIT-IC M8x80

### Sieve sleeve HIT- SC 16 to 22



**ANNEX A4**  
**Product description**  
**Materials**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table A1: Materials**

<b>Designation</b>	<b>Material</b>
<b>Metal parts made of zinc coated steel</b>	
Threaded rod, HIT-V-5.8(F)	Strength class 5.8, $f_{uk} = 500 \text{ N}\cdot\text{mm}^{-2}$ , $f_{yk} = 400 \text{ N}\cdot\text{mm}^{-2}$ , Rupture elongation ( $l_0 = 5d$ ) > 8% ductile Electroplated zinc coated $\geq 5 \mu\text{m}$ , (F) Hot dip galvanized $\geq 45 \mu\text{m}$
Threaded rod, HIT-V-8.8(F)	Strength class 8.8, $f_{uk} = 800 \text{ N}\cdot\text{mm}^{-2}$ , $f_{yk} = 640 \text{ N}\cdot\text{mm}^{-2}$ , Rupture elongation ( $l_0 = 5d$ ) > 8% ductile Electroplated zinc coated $\geq 5 \mu\text{m}$ , (F) Hot dip galvanized $\geq 45 \mu\text{m}$
Internally threaded sleeve HIT-IC	$f_{uk} = 490 \text{ N}/\text{mm}^2$ , $f_{yk} = 390 \text{ N}\cdot\text{mm}^{-2}$ Rupture elongation ( $l_0 = 5d$ ) ( $l_0=5d$ ) > 8% ductile Electroplated zinc coated $\geq 5 \mu\text{m}$
Washer	Electroplated zinc coated $\geq 5 \mu\text{m}$ Hot dip galvanized $\geq 45 \mu\text{m}$
Nut	Strength class of nut adapted to strength class of threaded rod Electroplated zinc coated $\geq 5 \mu\text{m}$ , Hot dip galvanized $\geq 45 \mu\text{m}$
<b>Metal parts made of stainless steel</b>	
Threaded rod, HIT-V-R	Strength class 70 $f_{uk} = 700 \text{ N}\cdot\text{mm}^{-2}$ , $f_{yk} = 450 \text{ N}\cdot\text{mm}^{-2}$ , Rupture elongation ( $l_0 = 5d$ ) > 8% ductile Stainless steel 1.4401, 1.4404, 1.4578, 1.4571, 1.4439, 1.4362 EN 10088-1: 2014
Washer	Stainless steel 1.4401, 1.4404, 1.4578, 1.4571, 1.4439, 1.4362 EN 10088-1: 2014
Nut	Strength class of nut adapted to strength class of threaded rod Stainless steel 1.4401, 1.4404, 1.4578, 1.4571, 1.4439, 1.4362 EN 10088-1: 2014
<b>Metal parts made of high corrosion resistant steel</b>	
Threaded rod, HIT-V-HCR	$f_{uk} = 800 \text{ N}/\text{mm}^2$ , $f_{yk} = 640 \text{ N}\cdot\text{mm}^{-2}$ , Rupture elongation ( $l_0 = 5d$ ) > 8% ductile High corrosion resistant steel 1.4529, 1.4565 EN 10088-1: 2014
Washer	High corrosion resistant steel 1.4529, 1.4565 EN 10088-1: 2014
Nut	Strength class of nut adapted to strength class of threaded rod High corrosion resistant steel 1.4529, 1.4565 EN 10088-1: 2014
<b>Plastic parts</b>	
Sieve sleeve HIT-SC	Frame: FPP 20T Sieve: PA6.6 N500/200



**ANNEX B1**  
**Intended Use**  
**Specifications**


This annex applies to the product described in the main body of the UK Technical Assessment.

**Specifications of intended use**

**Base materials:**

- Solid brick masonry (use category b), according to Annex B3.  
 Note: The characteristic resistances are also valid for larger brick sizes and larger compressive strengths of the masonry unit.
- Hollow brick masonry (use category c), according to Annex B3 and B5.
- Mortar strength class of the masonry: M2,5 at minimum according to EN 998-2: 2010.
- For masonry made of other solid, hollow or perforated bricks, the characteristic resistance of the anchor may be determined by job site tests according to UKAD 330076-00-0604, Annex B under consideration of the  $\beta$ -factor according to Annex C1, Table C1.

**Table B1: Overview use categories**

Anchorages subject to:		HIT-HY 270 with threaded rod, HIT-V or HIT-IC	
		In solid bricks	In hollow bricks
Hole drilling		Hammer mode	Rotary mode
Static and quasi static loading		Annex : C1 (Steel), C3 to C20	Annex : C1 (Steel), C21 to C30
Use category: dry or wet structure		Category d/d - Installation and use in structures subject to dry internal conditions. Category w/d - Installation in dry or wet substrate and use in structures subject to dry internal conditions (except calcium silicate bricks). Category w/w - Installation and use in structures subject to dry or wet environmental conditions (except calcium silicate bricks).	
Installation direction Masonry		Horizontal	
Installation direction Ceiling brick		Overhead	
Use category		b (solid masonry)	c (hollow or perforated masonry)
Temperature in the base material at installation		+5° C to +40° C (Table B11)	-5° C to +40° C (Table B12)
In-service temperature	Temperature range Ta:	-40 °C to +40 °C	(Maximum long-term temperature +24 °C and maximum short-term temperature +40 °C)
	Temperature range Tb:	-40 °C to +80 °C	(Maximum long-term temperature +50 °C and maximum short-term temperature +80 °C)

## ANNEX B2 Intended Use Specifications

This annex applies to the product described in the main body of the UK Technical Assessment.

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal conditions, if no particularly aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal conditions, if other particularly aggressive conditions exist (high corrosion resistant steel).

Note: Particularly aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing products are used).

### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to supports, etc.).
- Anchorages under static or quasi-static loading are designed in accordance with: UKAD 330076-00-0604
- In case of a brick compressive strength  $f_b$  is smaller than the highest strength stated in the load table the load can be calculated according to the following Equation:

$$F_{Rk,act} = F_{Rk,ETA,(fb)} * (f_{b,act}/f_{b,ETA})^\alpha$$

$F_{Rk,act}$  = Resistance of the fastener in the actual masonry unit  
 $F_{Rk,ETA,(fb)}$  = Resistance of the fastener in the masonry unit stated in Annexes C3 to C30  
 $f_{b,act}$  = Actual normalised mean compressive strength of the masonry unit according to EN 772-1:2011  
 $f_{b,ETA}$  = Normalised mean compressive strength stated in Annexes C3 to C30  
 $\alpha$  = 0,5 for masonry units of clay or concrete and solid unit of calcium silicate  
 $\alpha$  = 0,75 for masonry units of perforated calcium silicate

- For hollow brick masonry. The shear load vertical to the free edge must be transferred via the vertical joint. (Completely filled joint or direct contact.)
- For hollow brick masonry shear load only without lever arm permitted.




### Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on the site.

**ANNEX B3**  
**Intended Use**  
**Brick types and properties**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table B2: Overview brick types and properties**

Brick type	Picture	Brick size [mm]	Compressive strength fb, UKTA [N·mm <sup>-2</sup> ]	Bulk density [kg·dm <sup>-3</sup> ]	Annex
Solid clay brick EN 771-1		≥ 240x115x52	12 / 20 / 40	2.0	C3/C4
Solid clay brick EN 771-1		≥ 240x115x72	10 / 20	2.0	C5/C7
Solid clay brick EN 771-1		≥ 240x115x113	12 / 20	2.0	C8/C10
Solid calcium silicate brick EN 771-2		≥ 240x115x113	12 / 28	2.0	C11/C12
Solid calcium silicate brick EN 771-2		≥ 248x240x248	12 / 20 / 28	2.0	C13/C16
Solid light weight concrete brick EN 771-3		≥ 240x115x113	4 / 6	0.9	C17/C18
Solid normal weight concrete brick EN 771-3		≥ 240x115x113	6 / 16	2.0	C19/C20
Hollow clay brick EN 771-1		300x240x238	12 / 20	1.4	C21/C22
Hollow calcium silicate brick EN 771-2		248x240x248	12 / 20	1.4	C23/C24
Hollow lightweight concrete brick EN 771-3		495x240x238	2 / 6	0.7	C25/C27
Hollow normal weight concrete brick EN 771-3		500x200x200	4 / 10	0.9	C28/C29
Hollow clay brick EN 771-1 Ceiling brick		250x510x180	EN 15037-3 class R2	1.0	C30

**ANNEX B4**  
**Intended Use**  
**Fastening elements and corresponding brick types**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table B3: Overview fastening elements (including sizes and embedment depths) and corresponding brick types**

Brick type	Picture	HIT-V <sup>1)</sup> 	HIT-IC 	HIT-V + HIT-SC 	HIT-IC + HIT-SC 	Annex
Solid clay brick EN 771-1		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C3/C4
Solid clay brick EN 771-1		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C5/C7
Solid clay brick EN 771-1		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C8/C10
Solid calcium silicate brick EN 771-2		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C11/C12
Solid calcium silicate brick EN 771-2		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C13/C16
Solid light weight concrete brick EN 771-3		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C17/C18
Solid normal weight concrete brick EN 771-3		M8 to M16 h <sub>ef</sub> = 50 mm to 300 mm	M8 to M12	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C19/C20
Hollow clay brick EN 771-1		-	-	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C21/C22
Hollow calcium silicate brick EN 771-2		-	-	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C23/C24
Hollow lightweight concrete brick EN 771-3		-	-	M8 to M16 h <sub>ef</sub> = 80 mm to 160 mm	M8 to M12	C25/C27
Hollow normal weight concrete brick EN 771-3		-	-	M8 to M16 h <sub>ef</sub> = 50 mm to 160 mm	M8 to M12	C28/C29
Hollow clay brick EN 771-1 Ceiling brick		-	-	M6 h <sub>ef</sub> = 80 mm	-	C30


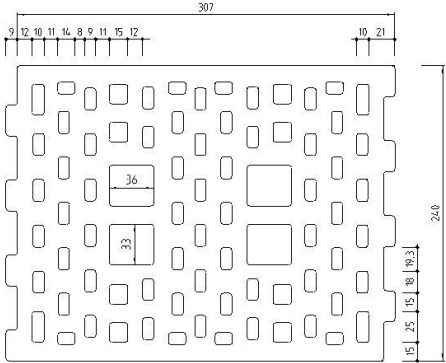

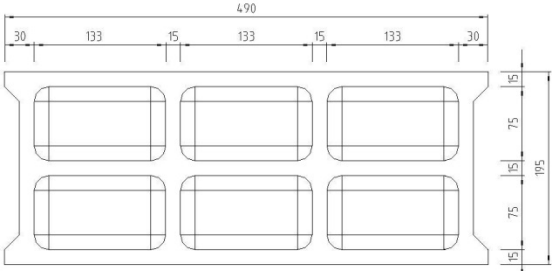

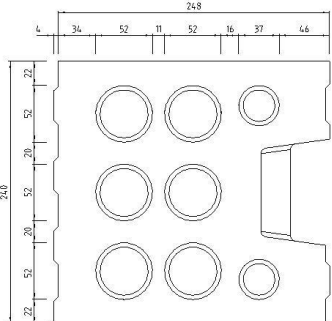

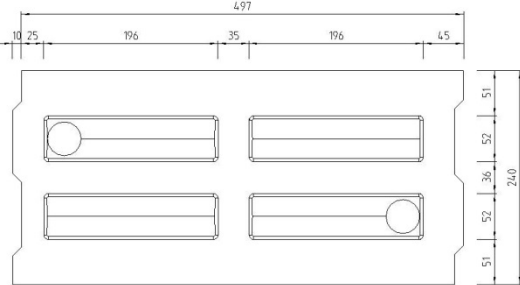

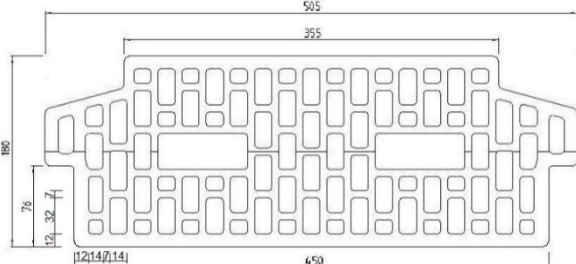
1) Commercially available rods can be used instead of HIT-V

**ANNEX B5**

**Intended Use  
Details of hollow bricks**

This annex applies to the product described in the main body of the UK Technical Assessment.


**Table B4: Details of hollow bricks**

<p>Hollow clay brick EN 771-1</p> <p>Rapis Ziegel Hlz 12-1.4-10DF</p>  	<p>Hollow normal weight concrete brick EN 771-3</p> <p>Parpaing creux B40</p>  
<p>Hollow calcium silicate brick EN 771-2</p> <p>KS Wemding KSL-R(P) 12-1.4 8DF</p>  	<p>Hollow lightweight concrete brick EN 771-3</p> <p>Knobel Betonwerk Hbl 4-0.8-500x240x238</p>  
	<p>Hollow clay brick EN 771-1</p> <p>Ceiling brick Fiedler Brick Ceiling Type 18+0 or 18+3</p>  


**ANNEX B6**  
**Intended Use**  
**Installation parameters**

This annex applies to the product described in the main body of the UK Technical Assessment.


**Table B5: Installation parameters of threaded rod, HIT-V-... with one sieve sleeve HIT-SC in hollow brick and solid brick (Figure A1)**

Threaded rod, HIT-V-...		M6	M8		M10		M12		M16	
<b>with HIT-SC</b>		<b>12x85</b>	<b>16x50</b>	<b>16x85</b>	<b>16x50</b>	<b>16x85</b>	<b>18x50</b>	<b>18x85</b>	<b>22x50</b>	<b>22x85</b>
Nominal diameter of drill bit	d <sub>0</sub> [mm]	12	16	16	16	16	18	18	22	22
Drill hole depth	h <sub>0</sub> [mm]	95	60	95	60	95	60	95	60	95
Effective embedment depth	h <sub>ef</sub> [mm]	80	50	80	50	80	50	80	50	80
Maximum diameter of clearance hole in the fixture	d <sub>f</sub> [mm]	7	9	9	12	12	14	14	18	18
Minimum wall thickness	h <sub>min</sub> [mm]	115	80	115	80	115	80	115	80	115
Brush HIT-RB	- [-]	12	16	16	16	16	18	18	22	22
Number of strokes HDM	- [-]	5	4	6	4	6	4	8	6	10
Number of strokes HDE 500-A	- [-]	4	3	5	3	5	3	6	5	8
Maximum torque moment for all brick types except "parpaing creux"	T <sub>max</sub> [Nm]	0	3	3	4	4	6	6	8	8
Maximum torque moment for "parpaing creux"	T <sub>max</sub> [Nm]	-	2	2	2	2	3	3	6	6

**Table B6: Installation parameters of threaded rod, HIT-V-... with two HIT-SC in hollow brick and solid brick for deeper embedment depth (Figure A2)**

Threaded rod, HIT-V-...		M8		M10	
<b>with HIT-SC</b>		<b>16x50+16x85</b>	<b>16x85+16x85</b>	<b>16x50+16x85</b>	<b>16x85+16x85</b>
Nominal diameter of drill bit	d <sub>0</sub> [mm]	16	16	16	16
Drill hole depth	h <sub>0</sub> [mm]	145	180	145	180
Effective embedment depth	h <sub>ef</sub> [mm]	130	160	130	160
Maximum diameter of clearance hole in the fixture	d <sub>f</sub> [mm]	9	9	12	12
Minimum wall thickness	h <sub>min</sub> [mm]	195	230	195	230
Brush HIT-RB	- [-]	16	16	16	16
Number of strokes HDM	- [-]	4+6	6+6	4+6	6+6
Number of strokes HDE-500	- [-]	3+5	5+5	3+5	5+5
Maximum torque moment	T <sub>max</sub> [Nm]	3	3	4	4



**Table B6 continued**

Threaded rod, HIT-V-...		M12		M16	
<b>with HIT-SC</b>		<b>18x50+18x85</b>	<b>18x85+18x85</b>	<b>22x50+22x85</b>	<b>22x85+22x85</b>
Nominal diameter of drill bit	d <sub>0</sub> [mm]	18	18	22	22
Drill hole depth	h <sub>0</sub> [mm]	145	180	145	180
Effective embedment depth	h <sub>ef</sub> [mm]	130	160	130	160
Maximum diameter of clearance hole in the fixture	d <sub>f</sub> [mm]	14	14	18	18
Minimum wall thickness	h <sub>min</sub> [mm]	195	230	195	230
Brush HIT-RB	- [-]	18	18	22	22
Number of strokes HDM	- [-]	4+8	8+8	6+10	10+10
Number of strokes HDE-500	- [-]	3+6	6+6	5+8	8+8
Maximum torque moment	T <sub>max</sub> [Nm]	6	6	8	8


**ANNEX B7**  
**Intended Use**  
**Installation parameters**

This annex applies to the product described in the main body of the UK Technical Assessment.


**Table B7: Installation parameters of internally threaded sleeve HIT-IC... with HIT-SC in hollow brick and solid brick (Figure A1)**

HIT-IC... 		M8x80	M10x80	M12x80
with HIT-SC 		16x85	18x85	22x85
Nominal diameter of drill bit	$d_0$ [mm]	16	18	22
Drill hole depth	$h_0$ [mm]	95	95	95
Effective embedment depth	$h_{ef}$ [mm]	80	80	80
Thread engagement length	$h_s$ [mm]	8...75	10...75	12...75
Maximum diameter of clearance hole in the fixture	$d_f$ [mm]	9	12	14
Minimum wall thickness	$h_{min}$ [mm]	115	115	115
Brush HIT-RB	- [-]	16	18	22
Number of strokes HDM	- [-]	6	8	10
Number of strokes HDE-500	- [-]	5	6	8
Maximum torque moment	$T_{max}$ [Nm]	3	4	6

**Table B8: Installation parameters of threaded rods, HIT-V-... in solid brick (Figure A3)**

Threaded rod, HIT-V-... 		M8	M10	M12	M16
Nominal diameter of drill bit	$d_0$ [mm]	10	12	14	18
Drill hole depth = Effective embedment depth	$h_0 = h_{ef}$ [mm]	50...300	50...300	50...300	50...300
Maximum diameter of clearance hole in the fixture	$d_f$ [mm]	9	12	14	18
Minimum wall thickness	$h_{min}$ [mm]	$h_0+30$	$h_0+30$	$h_0+30$	$h_0+36$
Brush HIT-RB	- [-]	10	12	14	18
Maximum torque moment	$T_{max}$ [Nm]	5	8	10	10



**Table B9: Installation parameters of internally threaded sleeve HIT-IC... in solid brick (Figure A4)**

HIT-IC... 		M8x80	M10x80	M12x80
Nominal diameter of drill bit	$d_0$ [mm]	14	16	18
Drill hole depth = Effective embedment depth	$h_0 = h_{ef}$ [mm]	80	80	80
Thread engagement length	$h_s$ [mm]	8...75	10...75	12...75
Maximum diameter of clearance hole in the fixture	$d_f$ [mm]	9	12	14
Minimum wall thickness	$h_{min}$ [mm]	115	115	115
Brush HIT-RB	- [-]	14	16	18
Maximum torque moment	$T_{max}$ [Nm]	5	8	10



**ANNEX B8**  
**Intended Use**  
**Installation parameters**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table B10: Installation parameters of threaded rod, HIT-V-... with two sieve sleeves HIT-SC for setting through the fixture and/or through the non- loadbearing layer in hollow brick and solid brick (Figure A5)**

Threaded rod, HIT-V-...		M8		M10	
<b>with HIT-SC</b>		<b>16x50+16x85</b>	<b>16x85+16x85</b>	<b>16x50+16x85</b>	<b>16x85+16x85</b>
Nominal diameter of drill bit	d <sub>0</sub> [mm]	16	16	16	16
Drill hole depth	h <sub>0</sub> [mm]	145	180	145	180
Minimum effective embedment depth	h <sub>ef,min</sub> [mm]	80	80	80	80
Maximum thickness of non-loadbearing layer and fixture (through setting)	h <sub>p,max</sub> [mm]	50	80	50	80
Maximum diameter of clearance hole in the fixture (pre-setting)	d <sub>f1</sub> [mm]	9	9	12	12
Maximum diameter of clearance hole in the fixture (through setting)	d <sub>f2</sub> [mm]	17	17	17	17
Minimum wall thickness	h <sub>min</sub> [mm]	h <sub>ef</sub> +65	h <sub>ef</sub> +70	h <sub>ef</sub> +65	h <sub>ef</sub> +70
Brush HIT-RB	- [-]	16	16	16	16
Number of strokes HDM	- [-]	4+6	6+6	4+6	6+6
Number of strokes HDE-500	- [-]	3+5	5+5	3+5	5+5
Maximum torque moment for all brick types except "parpaing creux"	T <sub>max</sub> [Nm]	3	3	4	4
Maximum torque moment for "parpaing creux"	T <sub>max</sub> [Nm]	2	2	2	2

**Table B10 continued**

Threaded rod, HIT-V-...		M12		M16	
<b>with HIT-SC</b>		<b>18x50+18x85</b>	<b>18x85+18x85</b>	<b>22x50+22x85</b>	<b>22x85+22x85</b>
Nominal diameter of drill bit	d <sub>0</sub> [mm]	18	18	22	22
Drill hole depth	h <sub>0</sub> [mm]	145	180	145	180
Minimum effective embedment depth	h <sub>ef,min</sub> [mm]	80	80	80	80
Maximum thickness of non-loadbearing layer and fixture (for through setting)	h <sub>p,max</sub> [mm]	50	80	50	80
Maximum diameter of clearance hole in the fixture (pre-setting)	d <sub>f1</sub> [mm]	14	14	18	18
Maximum diameter of clearance hole in the fixture (through setting)	d <sub>f2</sub> [mm]	19	19	23	23
Minimum Wall thickness	h <sub>min</sub> [mm]	h <sub>ef</sub> +65	h <sub>ef</sub> +70	h <sub>ef</sub> +65	h <sub>ef</sub> +70
Brush HIT-RB	- [-]	18	18	22	22
Number of strokes HDM	- [-]	4+8	8+8	6+10	10+10
Number of strokes HDE-500	- [-]	5+8	8+8	5+8	8+8
Maximum torque moment for all brick types except "parpaing creux"	T <sub>max</sub> [Nm]	6	6	8	8
Maximum torque moment for "parpaing creux"	T <sub>max</sub> [Nm]	3	3	6	6



**ANNEX B9**  
**Intended Use**  
**Installation parameters**  
**Cleaning tools**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table B11: Maximum working time and minimum curing time for solid bricks <sup>(1)</sup>**

Temperature in the base material T	Maximum working time $t_{work}$	Minimum curing time $t_{cure}$
5 °C to 9 °C	10 min	2.5 h
10 °C to 19 °C	7 min	1.5 h
20 °C to 29 °C	4 min	30 min
30 °C to 40 °C	1 min	20 min




<sup>(1)</sup> The curing time data are valid for dry base material only. In wet base material the curing times must be doubled.

**Table B12: Maximum working time and minimum curing time for hollow bricks <sup>(1)</sup>**

Temperature in the base material T	Maximum working time $t_{work}$	Minimum curing time $t_{cure}$
-5 °C to -1 °C	10 min	6 h
0 °C to 4 °C	10 min	4 h
5 °C to 9 °C	10 min	2,5 h
10 °C to 19 °C	7 min	1,5 h
20 °C to 29 °C	4 min	30 min
30 °C to 40 °C	1 min	20 min

<sup>(1)</sup> The curing time data are valid for dry base material only. In wet base material the curing times must be doubled.






**Table B13: Cleaning alternatives**

<p><b>Manual Cleaning (MC):</b>            Hilti hand pump for blowing out drill hole diameter <math>d_0 \leq 18</math> mm and drill hole depth up to <math>h_0 = 100</math> mm.</p>	
<p><b>Compressed air cleaning (CAC):</b>            Air nozzle with an orifice opening of minimum 3.5 mm in diameter for blowing out drill hole depth up to <math>h_0 = 300</math> mm.</p>	
<p><b>Steel brush HIT-RB:</b>            According to Tables B5 to B10 depending on drill hole diameter for MC and CAC.</p>	

**ANNEX B10**  
**Intended Use**  
**Installation instructions**

This annex applies to the product described in the main body of the UK Technical Assessment.


**Installation**

<b>Hole drilling</b>	If no significant resistance is felt over the entire depth of the hole when drilling (e.g. in unfilled butt joints), the anchor should not be set at this position.
<b>Drilling mode</b>	
	<p><b>In hollow bricks (use category c): rotary mode</b>          Drill hole to the required embedment depth with a hammer drill set in rotation mode using an appropriately sized carbide drill bit.</p>
	<p><b>In solid bricks (use category b): hammer mode</b>          Drill hole to the required embedment depth with a hammer drill set in hammer mode using an appropriately sized carbide drill bit.</p>
<b>Drill hole cleaning</b>	Just before setting the anchor, the drill hole must be free of dust and debris. Inadequate hole cleaning = poor load values.
<b>Manual Cleaning (MC) or Compressed Air Cleaning (CAC) for hollow and solid bricks</b>	
	<p>Blow 2 times from the back of the hole (if needed with nozzle extension) over the hole length with Hilti hand pump (drill hole diameter <math>d_0 \leq 18</math> mm and drill hole depth up to <math>h_0 = 100</math> mm) or oil-free compressed air (minimum 6 bar at <math>6 \text{ m}^3 \cdot \text{h}^{-1}</math>; drill hole depth up to <math>h_0 = 300</math> mm) until return air stream is free of noticeable dust.</p>
	<p>Brush 2 times with the specified steel brush (Tables B5 to B10) by inserting the steel brush Hilti HIT-RB to the back of the hole (if needed with extension) in a twisting motion and removing it.          The brush must produce natural resistance as it enters the drill hole (brush <math>\varnothing \geq</math> drill hole <math>\varnothing</math>) - if not the brush is too small and must be replaced with the proper brush diameter.</p>
	<p>Blow again with Hilti hand pump or compressed air 2 times until return air stream is free of noticeable dust.</p>


**ANNEX B11**  
**Intended Use**  
**Installation instructions**

This annex applies to the product described in the main body of the UK Technical Assessment.


**Injection preparation in masonry with holes or voids: installation with sieve sleeve HIT-SC**



**Single sieve sleeve HIT-SC**  
 Close lid




**Two sieve sleeves HIT-SC**  
 Plug sieve sleeves together. Discard superfluous lid.  
 Observe the sieve sleeve order in case of different sieve sleeve lengths: the shorter sleeve must be plugged into longer sleeve.




Insert sieve sleeve manually.  
 When using two sieve sleeves, the longer sieve sleeve must be inserted first.

**For all applications**




Tightly attach new Hilti mixing nozzle HIT-RE-M to foil pack manifold (snug fit). Do not modify the mixing nozzle.  
 Observe the instruction for use of the dispenser and foil pack.  
 Check foil pack holder for proper function. Do not use damaged foil packs / holders. Insert foil pack into foil pack holder and put holder into HIT-dispenser.




Discard initial adhesive. The foil pack opens automatically as dispensing is initiated. Depending on the size of the foil pack an initial amount of adhesive has to be discarded. Discarded quantities are  
 2 strokes for 330 ml foil pack,  
 3 strokes for 500 ml foil pack.

**Inject adhesive without forming air voids**


**Installation with sieve sleeve HIT-SC**



**Single sieve sleeve HIT-SC**  
 Insert mixer approximately 1 cm through the lid. Inject the required amount of adhesive (see Tables B5 to B10). Adhesive must emerge through the lid.



**Two sieve sleeves HIT-SC**  
 Use extension for installation with two sieve sleeves.  
 Insert mixer approximately 1 cm through the tip of sieve sleeve "2" and inject the required amount of adhesive into sieve sleeve "1" (see Tables B5 to B10).  
 Withdraw mixer to the point where it extends about 1 cm through the lid into the sleeve "2". Continue injecting in sieve sleeve "2" as described above.




Control the amount of injected mortar. Adhesive must protrude into the lid.  
 After injection is completed, depressurise the dispenser by pressing the release trigger. This will prevent further adhesive discharge from the mixer.

**ANNEX B12**  
**Intended Use**  
**Installation instructions**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Solid bricks: installation without sieve sleeve**




Inject the adhesive starting at the back of the hole, slowly withdrawing the mixer with each trigger pull.

Fill holes approximately 2/3 full to ensure that the annular gap between the anchor and the base material is completely filled with adhesive along the embedment length.

After injection is completed, depressurise the dispenser by pressing the release trigger. This will prevent further adhesive discharge from the mixer.


**Setting the element:**

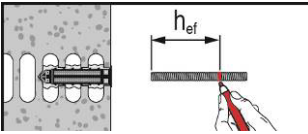Before use, verify that the element is dry and free of oil and other contaminants.




**HIT-V-... or HIT-IC in hollow and solid bricks:  
 Pre-setting (Figure A1 to Figure A4)**

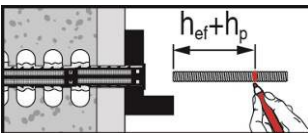Mark and set element to the required embedment depth until working time  $t_{work}$  has elapsed. The working time  $t_{work}$  is given in Tables B11 and B12.



**HIT-V-... in hollow and solid bricks:  
 setting through the fixture (Figure A5a)  
 or through the non-loadbearing layer and the fixture (Figure A5b)**

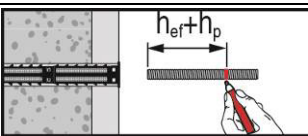
Mark and set element to the required embedment depth until working time  $t_{work}$  has elapsed. The working time  $t_{work}$  is given in Tables B11 and B12.



**HIT-V-... in hollow and solid bricks:  
 setting through the non-loadbearing (Figure A5c)**

Mark and set element to the required embedment depth until working time  $t_{work}$  has elapsed. The working time  $t_{work}$  is given in Tables B11 and B12.

**Loading the anchor**

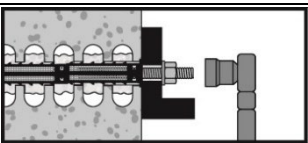

After required curing time  $t_{cure}$  (see Tables B11 and B12) the anchor can be loaded.

The applied installation torque shall not exceed the values  $T_{max}$  given in Tables B5 to B10.

## ANNEX C1

### Performances

β-factors for job-site testing under tension load

Characteristic resistances under tension and shear load – steel failure

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C1: β-factor for job-site testing under tension loading**

Use categories		w/w and w/d		d/d	
Temperature range		Ta*	Tb*	Ta*	Tb*
Base material	Cleaning				
Solid clay brick EN 771-1	CAC	0.96	0.96	0.96	0.96
	MC	0.84	0.84	0.84	0.84
Solid calcium silicate brick EN 771-2	CAC/MC	-	-	0.96	0.80
Solid light weight concrete brick EN 771-3	CAC	0.82	0.68	0.96	0.80
	MC	0.81	0.67	0.90	0.75
Solid normal weight concrete brick EN 771-3	CAC/MC	0.96	0.80	0.96	0.80
Hollow clay brick EN 771-1	CAC	0.96	0.96	0.96	0.96
	MC	0.84	0.84	0.84	0.84
Hollow calcium silicate brick EN 771-2	CAC/MC	-	-	0.96	0.80
Hollow light weight concrete brick EN 771-3	CAC	0.69	0.57	0.81	0.67
	MC	0.68	0.56	0.76	0.63
Hollow normal weight concrete brick EN 771-3	CAC/MC	0.96	0.80	0.96	0.80

\*Temperature range Ta / Tb see Annex B1

**Table C2: Characteristic values of steel resistance for threaded rods. HIT-V under tension and shear loads in masonry.**

Steel failure tension loads		M6	M8	M10	M12	M16
Characteristic steel resistance	$N_{Rk,s}$ [kN]	$A_s \cdot f_{uk}$				
Steel failure shear loads without lever arm						
Characteristic steel resistance	$V_{Rk,s}$ [kN]	$0.5 \cdot A_s \cdot f_{uk}$				
Steel failure shear loads with lever arm						
Characteristic bending moment	$M_{Rk,s}$ [kN]	$1.2 \cdot W_{el} \cdot f_{uk}$				


**Table C3: Characteristic values of steel resistance for internally threaded sleeve HIT-IC under tension and shear loads in masonry.**

Steel failure tension loads		M8	M10	M12
HIT-IC	$N_{Rk,s}$ [kN]	5.9	7.3	13.8
Partial safety factor	$\gamma_{Ms,N}$ [-]	1.50		
Steel failure shear loads without lever arm for threaded rods or screws				
Characteristic steel resistance	$V_{Rk,s}$ [kN]	$0.5 \cdot A_s \cdot f_{uk}$		
Steel failure shear loads with lever arm for threaded rods or screws				
Characteristic bending moment	$M_{Rk,s}$ [kN]	$1.2 \cdot W_{el} \cdot f_{uk}$		

**ANNEX C2**  
**Performances**  
**Anchor spacing**  
**Shear load direction**

This annex applies to the product described in the main body of the UK Technical Assessment.

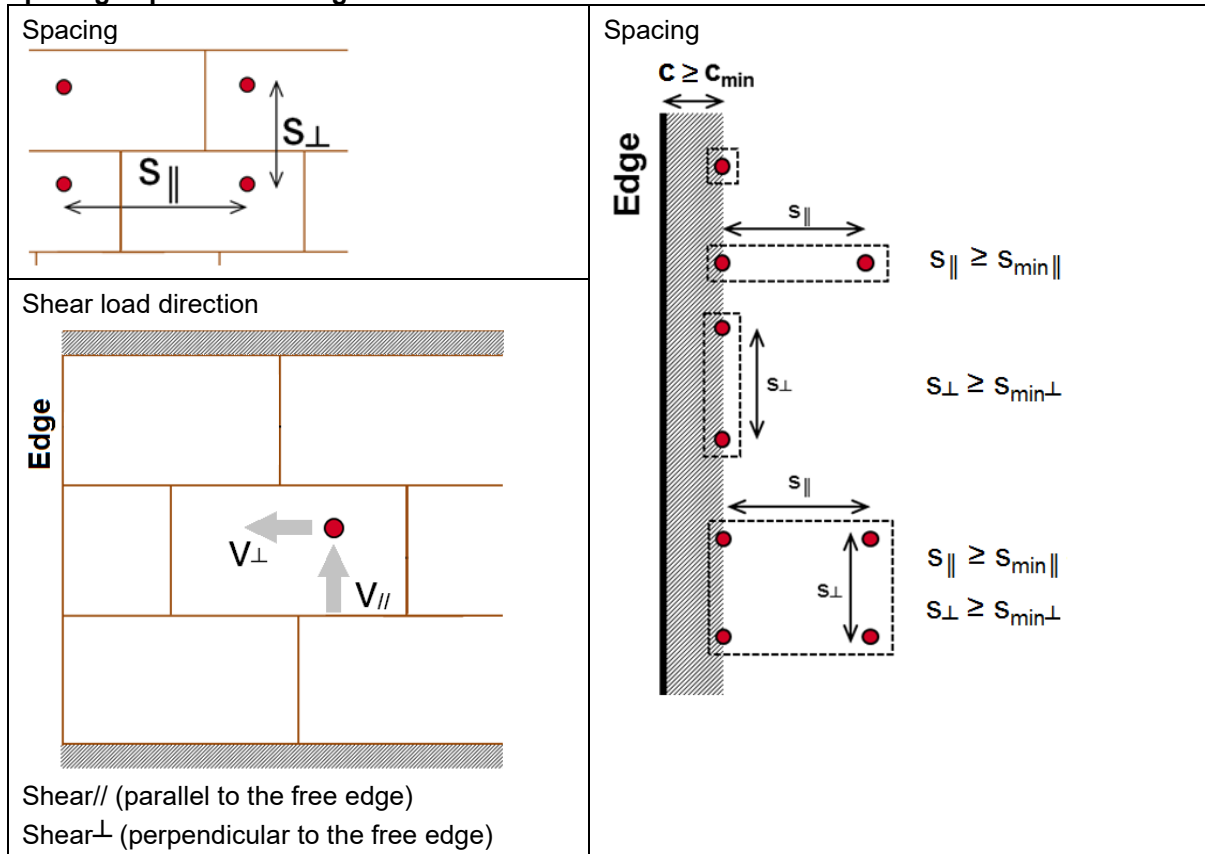**Spacing dependent on edge distances for all anchor combinations:**



The characteristic values of resistance of an anchor group are calculated by using the group-factors  $\alpha_g$  according to Annexes C3 to C30:

Group of two anchors:  $N_{Rk}^g = \alpha_{g,N} \cdot N_{Rk}$  and  $V_{Rk}^g = \alpha_{g,V} \cdot V_{Rk}$  (with the relevant  $\alpha_g$ )

Group of four anchors:  $N_{Rk}^g = \alpha_{g,N||} \cdot \alpha_{g,N\perp} \cdot N_{Rk}$  and  $V_{Rk}^g = \alpha_{g,V||} \cdot \alpha_{g,V\perp} \cdot V_{Rk}$

### ANNEX C3


#### Performances solid clay brick Mz, 1DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Brick type: Solid clay brick Mz, 1DF**

**Table C4: Description of brick**

Brick type		Solid Mz, 1DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	2.0	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 12, ≥ 20 or ≥ 40	
Code		EN 771 - 1	
Producer			
Brick dimensions	[mm]	≥ 240 x 115 x 52	
Minimum wall thickness	$h_{min}$ [mm]	≥ 115	






**Characteristic resistances for all anchor combinations (see Table B3)**

**Table C5: Tension resistance at edge distance  $c \geq 115$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{RK, p} = N_{RK, b}$ [kN]			
All anchor	≥ 50	12	1.5 (2.0*)			
		20	2.0 (2.5*)			
		40	3.5 (4.0*)			
	≥ 80	12	2.5 (3.0*)			
		20	3.5 (4.0*)			
		40	5.5 (6.5*)			
	≥ 100	12	3.5 (4.0*)			
		20	4.5 (5.0*)			
		40	7.0 (8.0*)			

\* CAC cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	115	-	-	-	-	-	-
	115	55	1,0		115	75	1,35
	115	115	2,0		115	3 $h_{ef}$	2,0

## ANNEX C4

### Performances solid clay brick Mz, 1DF

#### Characteristic values of resistance under shear load and group factor










#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C6: Shear resistance at edge distance  $c \geq 115$  mm (for  $V_{II}$ ) and  $c \geq 1,5 h_{ef}$  (for  $V_{\perp}$ )**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$
HIT-V M8; M10 HIT-IC M8	$\geq 50$	12	2.5	Calculate according to UKAD 330076-00-0604
		20	3.0	
		40	4.0	
HIT-V M12; M16 HIT-IC M10; M12	$\geq 50$	12	3.5	
		20	4.5	
		40	5.5	
HIT-V M8; M10 HIT-IC M8	$\geq 80$	12	5.0	
		20	6.0	
		40	7.5	
HIT-V M12; M16 HIT-IC M10; M12	$\geq 80$	12	6.5	
		20	8.5	
		40	10.5	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	115	-	-		1.5 h <sub>ef</sub>	-	-
	115	55	1.0		1.5 h <sub>ef</sub>	55	1.0
	115	115	2.0		1.5 h <sub>ef</sub>	3 h <sub>ef</sub>	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
-	-	-	-		1.5 h <sub>ef</sub>	115	1.0
	115	75	2.0		1.5 h <sub>ef</sub>	3 h <sub>ef</sub>	2.0

**Table C7: Displacements**

$h_{ef}$	N	$\delta_{N0}$	$\delta_{N\infty}$	V	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
50	1.2	0.1	0.2	1.4	0.5	0.75
80	2.1	0.1	0.2	2.1	1.1	1.65
100	3.9	0.2	0.4	3.0	1.3	1.95



## ANNEX C5


### Performances solid clay brick Mz. NF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Brick type: Solid clay brick Mz. NF**

**Table C8: Description of brick**

Brick type		Solid Mz. NF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	2.0	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 10 / 20	
Code		EN 771 - 1	
Producer			
Brick dimensions	[mm]	≥ 240 x 115 x 71	
Minimum wall thickness	$h_{min}$ [mm]	≥ 115	







#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C9: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	10	1.5 (1.5*)			
		20	2.0 (2.0*)			
	≥ 80	10	2.5 (3.0*)			
		20	3.5 (4.0*)			

\*CAC cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	75	1.0		115	50	1.0
-	-	-	-		50	115	1.15
	50	150	2.0		50	3 $h_{ef}$	2.0

## ANNEX C6

### Performances solid clay brick Mz. NF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C10: Tension resistance at edge distance for  $h_{ef} \geq 100$  mm at  $c \geq 150$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	$\geq 100$	10	4.0 (4.5*)			
		20	5.5 (6.0*)			

\* CAC cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel} \geq$ [mm]	
	150	-	-	-	-	-	-
	150	75	1.40		150	50	0.75
-	-	-	-		150	115	1.35
	150	150	2.0		150	3 $h_{ef}$	2.0

**Table C11: Shear resistance at edge distance  $c \geq 1.5 h_{ef}$**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N/mm <sup>2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$
All anchor	$\geq 50$	10	3.0	Calculate according to UKAD 330076-00-0604
		20	4.5	
HIT-V M8; M10 HIT-IC M8	$\geq 80$	10	5.0	
		20	7.0	
HIT-V M8; M10	$\geq 100$	10	8.0	
		20	11.0	
HIT-V M12; M16 HIT-IC M10; M12	$\geq 80$	10	9.0	
		20	12.0	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel} \geq$ [mm]	$\alpha_g$ [-]
	1.5 $h_{ef}$	-	-		1.5 $h_{ef}$	-	-
	1.5 $h_{ef}$	75	1.55		1.5 $h_{ef}$	75	1.0
	1.5 $h_{ef}$	150	2.0		1.5 $h_{ef}$	3 $h_{ef}$	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	1.5 $h_{ef}$	50	1.2		1.5 $h_{ef}$	50	1.60
	1.5 $h_{ef}$	75	1.5		1.5 $h_{ef}$	3 $h_{ef}$	2.0
	1.5 $h_{ef}$	115	2.0	-	-	-	-

## ANNEX C7

### Performances solid clay brick Mz. NF

#### Characteristic values of resistance under shear load and group factor






#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C12: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N/mm <sup>2</sup> ]	$V_{Rk,b} = V_{Rk,c II}$ [kN]
All anchor	$\geq 50$	10	3.0
		20	4.5
	$\geq 80$	10	4.0
		20	5.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-
	50	75	1.55
	50	150	2.0
Configuration	$c \geq$ [mm]	$s_{  }$ [mm]	$\alpha_g$ [-]
	50	50	1.2
	50	115	2.0

**Table C13: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
50	0.8	0.1	0.2	1.6	0.8	1.2
80	1.5	0.1	0.2	2.1	0.8	1.2
100	2.3	0.1	0.2	2.1	0.8	1.2

## ANNEX C8


### Performances solid clay brick Mz. 2DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Brick type: Solid clay brick Mz. 2DF**

**Table C14: Description of brick**

Brick type		Solid Mz. 2DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 2.0	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 12 / 20	
Code		EN 771 - 1	
Producer			
Brick dimensions	[mm]	≥ 240 x 115 x 113	
Minimum wall thickness	$h_{min}$ [mm]	≥ 115	







#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C15: Tension resistance at edge distance  $c \geq 115$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	12	2.5 (3.0*)			
		20	2.5 (3.0*)			
	≥ 80	12	3.5 (4.0*)			
		20	4.5 (5.5*)			
	≥ 100	12	6.0 (7.0*)			
		20	7.0 (8.0*)			

\* CAC cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	115	-	-	-	-	-	-
	115	75	1.0		115	75	1.50
	115	115	1.60	-	-	-	-
	115	3 $h_{ef}$	2.0		115	3 $h_{ef}$	2.0

## ANNEX C9

### Performances solid clay brick Mz. 2DF

#### Characteristic values of resistance under tension and shear load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C16: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	$\geq 50$	12	1.5 (1.5*)			
		20	2.0 (2.0*)			
	$\geq 80$	12	3.0 (3.5*)			
		20	3.5 (4.0*)			

\* CAC cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	75	1.10		115	50	1.0
	50	115	1.45		50	115	1.15
	50	3 $h_{ef}$	2.0		50	3 $h_{ef}$	2.0

**Table C17: Shear resistance at edge distance  $c \geq 1.5 h_{ef}$**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c   }$ [kN]	$V_{Rk,c \perp}$
All anchor	$\geq 50$	12	5.5	Calculate according to UKAD 330076-00-0604 (for $h_{ef} > 80$ mm calculate with $h_{ef} = 80$ mm)
		20	7.0	
HIT-V M8; M10 HIT-IC M8	$\geq 80$	12	8.0	
		20	10.0	
HIT-V M12 HIT-IC M10	$\geq 80$	12	10.5	
		20	12.0	
HIT-V M16 HIT-IC M12	$\geq 80$	12	12.0	
		20	12.0	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} c$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	1.5 $h_{ef}$	-	-		1.5 $h_{ef}$	-	-
	1.5 $h_{ef}$	75	0.85		1.5 $h_{ef}$	115	0.75
	1.5 $h_{ef}$	3 $h_{ef}$	2.0		1.5 $h_{ef}$	3 $h_{ef}$	2.0
Configuration	$c \geq$ [mm]	$s_{  }$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  }$ [mm]	$\alpha_g$ [-]
	1.5 $h_{ef}$	115	1.60		1.5 $h_{ef}$	115	0.8
	1.5 $h_{ef}$	3 $h_{ef}$	2.0		1.5 $h_{ef}$	3 $h_{ef}$	2.0

## ANNEX C10

### Performances solid clay brick Mz. 2DF

#### Characteristic values of resistance under shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C18: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c II}$ [kN]
All anchor	$\geq 50$	12	3.0
		20	4.0
All anchor	$\geq 80$	12	4.5
		20	5.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-
	50	75	0.70
	50	115	1.5
	50	3 h <sub>ef</sub>	2.0
Configuration	$c \geq$ [mm]	$s_{  }$ [mm]	$\alpha_g$ [-]
	50	115	2.0

**Table C19: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
50	0.9	0.1	0.2	1.9	0.6	0.9
80	1.3	0.2	0.4	2.8	1.0	1.5
100	1.7	0.3	0.6	2.8	1.0	1.5

## ANNEX C11


### Performances solid silica brick KS. 2DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Solid calcium silicate brick KS. 2DF

**Table C20: Description of brick**







Brick type		Solid KS. 2DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 2.0	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 12 / 28	
Code		EN 771 - 2	
Producer			
Brick dimensions	[mm]	≥ 240 x 115 x 113	
Minimum wall thickness	$h_{min}$ [mm]	≥ 115	

#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C21: Tension resistance at edge distance  $c \geq 115$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	12	-	-	6.0	5.0
		28	-	-	9.0	7.5

Related edge and spacing distance and group factor  $\alpha_g$




Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	115	-	-	-	-	-	-
	115	50	1.0		115	50	1.0
	115	115	1.45	-	-	-	-
	115	150	2.0		115	115 (H)* 240 (S)*	2.0

\* (H) = Header. (S) = Stretcher

**Table C22: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	12	-	-	4.0	3.5
		28	-	-	6.5	5.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	115	2.0		50	115 (H)* 240 (S)*	2.0

\* (H) = Header. (S) = Stretcher

## ANNEX C12

### Performances solid silica brick KS. 2DF

#### Characteristic values of resistance under tension and shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C23: Shear resistance at edge distance  $c \geq 115$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [ $N \cdot mm^{-2}$ ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$
All anchor	$\geq 50$	12	6.0	Calculate according to UKAD 330076-00-0604
		28	9.0	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	115	-	-		115	-	-
	115	50	0.45		115	50	0.45
	115	115	2.0		115	115	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	115	50	0.45		115	50	0.45
	115	115 (H)* 240 (S)*	2.0		115	115 (H)* 240 (S)*	2.0

\* (H) = Header. (S) = Stretcher

**Table C24: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [ $N \cdot mm^{-2}$ ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}$ [kN]
All anchor	$\geq 50$	12	3.0
		28	4.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		50	-	-
	50	115	2.0		50	115	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	50	115 (H)* 240 (S)*	2.0		50	115 (H)* 240 (S)*	2.0

\* (H) = Header. (S) = Stretcher

**Table C25: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
$\geq 50$	2.5	0.3	0.6	2.5	1.0	1.5



## ANNEX C13


### Performances solid silica brick KS. 8DF

#### Characteristic values of resistance under tension load

This annex applies to the product described in the main body of the UK Technical Assessment.











#### Brick type: Solid calcium silicate brick KS. 8DF

**Table C26: Description of brick**

Brick type		Solid KS. 8DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 2.0	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 12 / 20 / 28	
Code		EN 771 - 2	
Producer			
Brick dimensions	[mm]	≥ 248 x 240 x 248	
Minimum wall thickness	$h_{min}$ [mm]	≥ 240	

#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C27: Tension resistance at edge distance  $c \geq 120$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	12	-	-	7.0	5.5
		20	-	-	9.0	7.5
		28	-	-	10.5	8.5
HIT-V 	M8. M10	12	-	-	8.5	7.0
		20	-	-	11.0	9.0
		28	-	-	12.0	10.5
HIT-V 	M12	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-IC 	M8. M10	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-V + HIT-SC 	M8. M10	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-IC + HIT-SC 	M8	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-V 	M16	12	-	-	12.0	12.0
		20	-	-	12.0	12.0
HIT-IC 	M12	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-V + HIT-SC 	M12. M16	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-IC + HIT-SC 	M10. M12	12	-	-	11.5	9.5
		20	-	-	12.0	12.0
HIT-V 	M8. M10	12	-	-	12.0	11.0
		20	-	-	12.0	12.0
		28	-	-	12.0	12.0



## ANNEX C14

### Performances solid silica brick KS. 8DF




#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.











**Table C27 continued**

HIT-V 	M12. M16	≥ 100	12	-	-	12.0	12.0
HIT-V + HIT-SC 	M8 to M16		20	-	-	12.0	12.0
			28	-	-	12.0	12.0

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel} \geq$ [mm]	$\alpha_g$ [-]
	120	-	-	-	-	-	-
	120	3 hef	2.0		120	3 hef	2.0

**Table C28: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	12	-	-	4.0	3.5
		20	-	-	5.5	4.5
		28	-	-	6.5	5.0
HIT-V 	M8. M10	12	-	-	5.0	4.0
		20	-	-	6.5	5.5
		28	-	-	7.5	6.5
HIT-V 	M12	12	-	-	7.0	5.5
		20	-	-	9.0	7.5
HIT-IC 	M8. M10	20	-	-	9.0	7.5
		28	-	-	10.5	8.5
HIT-V + HIT-SC 	M8. M10	20	-	-	9.0	7.5
		28	-	-	10.5	8.5
HIT-IC + HIT-SC 	M8	20	-	-	9.0	7.5
		28	-	-	10.5	8.5
HIT-V 	M16	12	-	-	10.0	8.0
		20	-	-	12.0	10.5
HIT-IC 	M12	12	-	-	10.0	8.0
		20	-	-	12.0	10.5
HIT-V + HIT-SC 	M12. M16	12	-	-	10.0	8.0
		20	-	-	12.0	10.5
HIT-IC + HIT-SC 	M10. M12	12	-	-	10.0	8.0
		20	-	-	12.0	10.5
HIT-V 	M8. M10	12	-	-	8.0	6.5
		20	-	-	10.5	8.5
		28	-	-	12.0	10.0





## ANNEX C15

### Performances solid silica brick KS. 8DF






#### Characteristic values of resistance under tension and shear load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.






**Table C28 continued**

HIT-V 	M12	≥ 100	12	-	-	9.5	8.0
HIT-V + HIT-SC 	M8. M10		20	-	-	12.0	10.0
			28	-	-	12.0	12.0
HIT-V 	M16		12	-	-	12.0	10.5
HIT-V + HIT-SC 	M12. M16		20	-	-	12.0	12.0
			28	-	-	12.0	12.0







Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	50	1.0		50	50	1.0
	50	3 $h_{ef}$	2.0		50	3 $h_{ef}$	2.0

**Table C29: Shear resistance at edge distance  $c \geq 120$  mm (for  $V_{II}$ ) and  $c \geq 1.5 h_{ef}$  (for  $V_{\perp}$ )**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$		
HIT-V 	≥ 50		12	Calculate according to UKAD 330076-00-0604		
M8. M10			9.0			
			20		12.0	
			28		12.0	
HIT-V 			M12. M16		12	12.0
HIT-IC 			M8 to M12		20	12.0
HIT-V + HIT-SC 	M12. M16	28	12.0			
HIT-IC + HIT-SC 	M8 to M12					

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	120	-	-		1.5 $h_{ef}$	-	-
	120	3 $h_{ef}$	2.0		1.5 $h_{ef}$	3 $h_{ef}$	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	120	3 $h_{ef}$	2.0		1.5 $h_{ef}$	3 $h_{ef}$	2.0

## ANNEX C16

### Performances solid silica brick KS. 8DF

#### Characteristic values of resistance under shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C30: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}$ [kN]
All anchor	$\geq 50$	12	3.0
		20	4.0
		28	4.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		50	-	-
	50	250	2.0		50	250	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	50	250	2.0		50	250	2.0

**Table C31: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
50	2.3	0.10	0.20	3.4	2.8	4.2
80	3.4	0.15	0.30	3.4	2.8	4.2
100	3.4	0.15	0.30	3.4	2.8	4.2

## ANNEX C17


### Performances solid lightweight concrete brick Vbl. 2DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Solid lightweight concrete brick Vbl. 2DF

**Table C32: Description of brick**

Brick type		Solid Vbl. 2DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 0.9	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 4 / 6	
Code		EN 771-3	
Producer			
Brick dimensions	[mm]	≥ 240 x 115 x 113	
Minimum wall thickness	$h_{min}$ [mm]	≥ 115	




#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C33: Tension resistance at edge distance  $c \geq 115$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	4	3.0	2.0	3.0 (3.5*)	2.5
		6	3.5	3.0	4.0	3.0 (3.5*)
	≥ 80	4	4.5	3.5	5.0	4.0 (4.5*)
		6	5.5	4.5	6.0 (6.5*)	5.0 (5.5*)
	≥ 100	4	6.0	5.0	6.5 (7.0*)	5.5 (6.0*)
		6	7.5	6.0	8.0 (8.5*)	6.5 (7.0*)

\* Compressed air cleaning only








Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	115	-	-	-	-	-	-
	115	3 $h_{ef}$	2.0		115	3 $h_{ef}$	2.0

**Table C34: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 50	4	1.5	1.2	1.5	1.5
		6	2.0	1.5	2.0	1.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	115	1.0		50	115	1.0
	115	50	1.0		115	50	1.0
	50	3 $h_{ef}$	2.0		50	3 $h_{ef}$	2.0

## ANNEX C18

### Performances solid lightweight concrete brick Vbl. 2DF

#### Characteristic values of resistance under tension and shear loads

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C35: Shear resistance at edge distance  $c \geq 115$  mm (for VII) and  $c \geq 1.5 h_{ef}$  (for V $^{\perp}$ )**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm $^{-2}$ ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$
HIT-V M8	$\geq 50$	4	2.0	Calculate according to UKAD 330076-00-0604
		6	2.5	
HIT-V M10 to M16		4	2.5	
HIT-IC M8 to M12		6	3.0	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	115	-	-		$1.5 h_{ef}$	-	-
	115	$3 h_{ef}$	2.0		$1.5 h_{ef}$	$3 h_{ef}$	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	115	$3 h_{ef}$	2.0		$1.5 h_{ef}$	$3 h_{ef}$	2.0

**Table C36: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm $^{-2}$ ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}$ [kN]
All anchor	$\geq 50$	4	1.20
		6	1.50

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		50	-	-
	115	50	1.0		115	50	1.0
	50	115	1.0		50	115	1.0
	50	$3 h_{ef}$	2.0		50	$3 h_{ef}$	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	115	50	1.0		115	50	1.0
	50	115	1.0		50	115	1.0
	50	$3 h_{ef}$	2.0		50	$3 h_{ef}$	2.0

**Table C37: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
$\geq 50$	2.5	0.3	0.6	1.8	2.0	3.0


## ANNEX C19

### Performances solid normal weight concrete brick Vbn. 2DF Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Solid normal weight concrete brick Vbn. 2DF

**Table C38: Description of brick**




Brick type		Solid Vbn. 2DF	
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	$\geq 2.0$	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	$\geq 6 / 16$	
Code		EN 771-3	
Producer			
Brick dimensions	[mm]	$\geq 240 \times 115 \times 113$	
Minimum wall thickness	$h_{min}$ [mm]	$\geq 115$	

#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C39: Tension resistance at edge distance  $c \geq 115$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	$\geq 50$	6	3.0	2.5	3.0	2.5
		16	5.5	4.5	5.5	4.5








Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	115	-	-	-	-	-	-
	115	3 $h_{ef}$	2.0		115	3 $h_{ef}$	2.0

**Table C40: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	$\geq 50$	6	1.5	1.2	1.5	1.2
		16	2.5	2.0	2.5	2.0

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	115	1.0		50	115	1.0
	115	50	1.0		115	50	1.0
	50	3 $h_{ef}$	2.0		50	3 $h_{ef}$	2.0

## ANNEX C20

### Performances solid normal weight concrete brick Vbn. 2DF

#### Characteristic values of resistance under shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C41: Shear resistance at edge distance  $c \geq 115$  mm (for VII) and  $c \geq 1.5 h_{ef}$  (for V $_{\perp}$ )**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]	$V_{Rk,c \perp}$
All anchor	$\geq 50$	6	4.0	Calculate according to UKAD 330076-00-0604
		16	6.5	

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	115	-	-		1.5 h <sub>ef</sub>	-	-
	115	3 h <sub>ef</sub>	2.0		1.5 h <sub>ef</sub>	3 h <sub>ef</sub>	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	115	3 h <sub>ef</sub>	2.0		1.5 h <sub>ef</sub>	3 h <sub>ef</sub>	2.0

**Table C42: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}$
All anchor	$\geq 50$	4	1.5
		6	3.0

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		50	-	-
	115	50	1.0		115	50	1.0
	50	115	1.0		50	115	1.0
	50	3 h <sub>ef</sub>	2.0		50	3 h <sub>ef</sub>	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	115	50	1.0		115	50	1.0
	50	115	1.0		50	115	1.0
	50	3 h <sub>ef</sub>	2.0		50	3 h <sub>ef</sub>	2.0

**Table C43: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
$\geq 50$	1.5	0.3	0.6	1.8	2.0	3.0



## ANNEX C21


### Performances hollow clay brick Hz. 10DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Hollow clay brick Hz. 10DF

**Table C44: Description of brick**

Brick type		Hz12-1.4-10 DF	 <p>Drawing of the brick see <b>Table B4</b></p>
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 1.4	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 12 / 20	
Code		EN 771 - 1	
Producer		Rapis (D)	
Brick dimensions	[mm]	300 x 240 x 238	
Minimum wall thickness	$h_{min}$ [mm]	≥ 240	




#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C45: Tension resistance at edge distance  $c \geq 150$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 80	12	5.5 (6.0*)			
		20	7.0 (8.0*)			

\* Compressed air cleaning only

Related edge and spacing distance and group factor  $\alpha_g$






Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	150	-	-	-	-	-	-
	150	240	2.0		150	300	2.0

**Table C46: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	≥ 80	12	1.5 (2.0*)			
		20	2.0 (2.5*)			

\* Compressed air cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	5 $d_0$	1.0		50	5 $d_0$	1.0
	50	240	2.0		50	300	2.0

## ANNEX C22

### Performances hollow clay brick Hz. 10DF

#### Characteristic values of resistance under shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C47: Shear resistance at edge distance  $c \geq 300$  mm**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}^{1)}$ [kN]
HIT-V M8. M10 HIT-IC M8	$\geq 80$	12	4.5
		20	5.5
HIT-V M12. M16 HIT-IC M10. M12		12	9.5
		20	10

1)  $V_{Rk,b}$  may be used as  $V_{Rk,c \perp}$  if

- Horizontal joints are completely filled with mortar and
- Vertical joints are completely filled with mortar or the bricks have completely direct contact to each other.

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	300	-	-		300	-	-
	300	240	2.0		300	240	1.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	300	300	2.0		300	300	2.0

**Table C48: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$c$ [mm]	$V_{Rk,c \perp}$ [kN]
All anchor	$\geq 80$	$\geq 50$	1.25
		$\geq 250$	2.5
		$c$ [mm]	$V_{Rk,b} = V_{Rk,c \parallel}$ [kN]
		$\geq 50$	1.25
		$\geq 100$ and $\geq 6 \cdot d_0$	2.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	see Table C48	-	-		see Table C48	-	-
	see Table C48	5 $d_0$	1.0		see Table C48	5 $d_0$	1.0
	see Table C48	240	2.0		see Table C48	240	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	see Table C48	5 $d_0$	1.0		see Table C48	5 $d_0$	1.0
	see Table C48	300	2.0		see Table C48	300	2.0

**Table C49: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
$\geq 80$	2.5	0.4	0.8	1.7	1.0	1.5

## ANNEX C23


### Performances hollow silica brick KSL. 8DF

#### Characteristic values of resistance under tension and shear load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Hollow calcium silicate brick KSL. 8DF

**Table C50: Description of brick**






Brick type		KSL-12-1.4-8 DF	 <p>Drawing of the brick see <b>Table B4</b></p>	
Bulk density	$\rho$	[kg·dm <sup>-3</sup> ]		≥ 1.4
Compressive strength	$f_b$	[N·mm <sup>-2</sup> ]		≥ 12 / 20
Code		EN 771 – 2		
Producer		KS Wemding (D)		
Brick dimensions		[mm]		248 x 240 x 238
Minimum wall thickness	$h_{min}$	[mm]		≥ 240

#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C51: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
HIT-V M8 to M16	≥ 80	12	-	-	4.0	3.0
		20	-	-	5.5	4.5
	≥ 130	12	-	-	5.0	4.0
		20	-	-	7.5	6.0
HIT-IC M8 to M12	80	12	-	-	4.0	3.0
		20	-	-	5.5	4.5

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	50	1.0		50	50	1.0
	50	240	2.0		50	250	2.0

**Table C52: Shear resistance at edge distance  $c \geq 125$  mm (for VII) and  $c \geq 250$  mm (for V<sup>⊥</sup>)**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \perp} = V_{Rk,c \perp}^{(1)}$ [kN]
HIT-V M8	≥ 80	12	6.0
		20	9.0
HIT-V M10 HIT-IC M8		12	9.0
		20	12.0
HIT-V M12 to M16 HIT-IC M10. M12		12	12.0
		20	12.0

<sup>(1)</sup>  $V_{Rk,b}$  may be used as  $V_{Rk,c \perp}$  if

- Horizontal joints are completely filled with mortar and
- Vertical joints are completely filled with mortar or the bricks have completely direct contact to each other and
- max  $V_{Rk,c \perp} = 9$  kN

## ANNEX C24

### Characteristic values of resistance under shear load and group factor Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	125	-	-		250	-	-
	125	240	2.0	-	-	-	-
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	125	250	2.0		250	250	2.0

**Table C53: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk.c.\perp}$ <sup>1)</sup> [kN]
All anchor	$\geq 80$	$\geq 50$	12	4.0
			20	6.0
		$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk.b} = V_{Rk.c.\parallel}$ [kN]
			$\geq 50$	12
		$\geq 50$	20	6.0

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		50	-	-
	50	50	1.0		50	50	1.0
	50	240	2.0		50	240	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	50	50	1.0		50	50	1.0
	50	250	2.0		50	250	2.0

<sup>1)</sup>  $\max V_{Rk.c.\perp} = 9$  kN

**Table C54: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
80	1.0	0.3	0.6	4.3	2.0	3.0
130	2.1	0.3	0.6	4.3	2.0	3.0

## ANNEX C25


### Performances hollow lightweight concrete brick Hbl. 16DF

#### Characteristic values of resistance under tension load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Hollow lightweight concrete brick Hbl. 16DF

**Table C55: Description of brick**

Brick type		Hbl-4-0.7	 <p>Drawing of the brick see <b>Table B4</b></p>
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 0.7	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 2 / 6	
Code		EN 771-3	
Producer		Knobel (D)	
Brick dimensions	[mm]	495 x 240 x 238	
Minimum wall thickness	$h_{min}$ [mm]	≥ 240	




#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C56: Tension resistance at edge distance  $c \geq 125$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
HIT-V M8 and M10.	≥ 80	2	3.5	3.0	4.0	3.0 (3.5*)
HIT IC M8		6	6.0	5.0	6.5 (7.0*)	5.5 (6.0*)
HIT-V M12 and M16	≥ 80	2	4.0	3.5	4.5	3.5 (4.0*)
HIT-IC M10 and M12		6	7.0	6.0	8.0	6.5 (7.0*)

\* Compressed air cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	125	-	-	-	-	-	-
	125	240	2.0		125	240	2.0

## ANNEX C26

### Performances hollow lightweight concrete brick Hbl. 16DF

#### Characteristic values of resistance under tension and shear load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C57: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
HIT-V M8 to M16	$\geq 80$	2	1.5	1.2	1.5	1.5
		6	2.5	2.0	3.0	2.5
	160	2	2.0	1.5	2.0	1.5 (2.0*)
		6	3.5	2.5	3.5 (4.0*)	3.0
HIT-IC M8 to M12	80	2	1.5	1.2	1.5	1.5
		6	2.5	2.0	3.0	2.5

\* Compressed air cleaning only

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	50	1.0		50	50	1.0
	50	240	2.0		50	240	2.0

**Table C58: Shear resistance at edge distance  $c \geq 250$  mm (for VII) and  $c \geq 500$  mm (for V<sup>⊥</sup>)**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c \parallel} = V_{Rk,c \perp}$ (1) [kN]
HIT-V M8. M10	$\geq 80$	2	4.0
HIT-IC M8.		6	6.5
HIT-V M12	$\geq 80$	2	5.5
HIT-IC M10		6	9.5
HIT-V M16	$\geq 80$	2	6.0
HIT-IC M12		6	10.0

(1)  $V_{Rk,b}$  may be used as  $V_{Rk,c \perp}$  if

- Horizontal joints are completely filled with mortar and
- Vertical joints are completely filled with mortar or the bricks have completely direct contact to each other.

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	250	-	-		500	-	-
	250	240	2.0		500	240	1.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	250	250	2.0		500	500	2.0

## ANNEX C27

### Performances hollow lightweight concrete brick Hbl. 16DF

#### Characteristic values of resistance under shear load and group factor

#### Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.

**Table C59: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk.c.⊥}$ [kN]
All anchor	$\geq 80$	$\geq 50$	2	1.5
			6	3.0
		$\geq 250$	2	2.5
		$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk.b} = V_{Rk.c.∥}$ [kN]
		$\geq 50$	2	1.5
			6	3.0
$\geq 100$ $\geq 6 d_0$	2	2.5		

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	see Table C59	-	-		see Table C59	-	-
	see Table C59	50	1.0		see Table C59	50	1.0
	see Table C59	240	2.0		see Table C59	240	2.0
Configuration	$c \geq$ [mm]	$s_{∥}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{∥}$ [mm]	$\alpha_g$ [-]
	see Table C59	50	1.0		see Table C59	50	1.0
	see Table C59	250	2.0		see Table C59	250	2.0

**Table C60: Displacements**

$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
80	0.8	0.20	0.4	2.3	1.0	1.5
160	1.1	0.25	0.5	2.3	1.0	1.5

## ANNEX C28


### Performances hollow normal weight concrete brick - parpaing creux

#### Characteristic values of resistance under tension and shear load and group factor

This annex applies to the product described in the main body of the UK Technical Assessment.

#### Brick type: Hollow normal weight concrete brick - parpaing creux

**Table C61: Description of brick**




Brick type		B40	 <p>Drawing of the brick see <b>Table B4</b></p>
Bulk density	$\rho$ [kg·dm <sup>-3</sup> ]	≥ 0.9	
Compressive strength	$f_b$ [N·mm <sup>-2</sup> ]	≥ 4 / 10	
Code		EN 771-3	
Producer		Fabemi (F)	
Brick dimensions	[mm]	500 x 200 x 200	
Minimum wall thickness	$h_{min}$ [mm]	≥ 200	

#### Characteristic resistances for all anchor combinations (see Table B3)

**Table C62: Tension resistance at edge distance  $c \geq 50$  mm**

Use category			w/w = w/d		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchors	≥ 50	4	0.9	0.9	0.9	0.9
		10	2.0	1.5	2.0	1.5
All anchors	≥ 130	4	1.5	1.2	1.5	1.2
		10	2.5	2.0	2.5	2.0

#### Related edge and spacing distance and group factor $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{  } \geq$ [mm]	$\alpha_g$ [-]
	50	-	-	-	-	-	-
	50	200	2.0		50	200	2.0

**Table C63: Shear resistance at edge distance  $c \geq 200$  mm (for VII) and  $c \geq 500$  mm (for V<sup>⊥</sup>)**

Anchor type and size	$h_{ef}$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk,c   } = V_{Rk,c \perp}$ <sup>1)</sup> [kN]
All anchors	≥ 50	4	4
		10	6.5
	≥ 80	4	5
		10	7.5

<sup>1)</sup>  $V_{Rk,b}$  may be used as  $V_{Rk,c \perp}$  if

- Horizontal joints are completely filled with mortar
- Vertical joints are completely filled with mortar or the bricks have completely direct contact to each other.









## ANNEX C29

### Performances hollow normal weight concrete brick - parpaing creux Characteristic values of resistance under shear load and group factor Displacements

This annex applies to the product described in the main body of the UK Technical Assessment.











Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	200	-	-		500	-	-
	200	200	2.0		500	200	1.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	200	200	2.0		500	500	2.0

**Table C64: Shear resistance at edge distance  $c \geq 50$  mm**

Anchor type and size	$h_{ef}$ [mm]	$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk.c,\perp}$ [kN]
All anchor	$\geq 50$	$\geq 50$	4	1.2
			10	1.5
		$\geq 250$	4/10	2.5
		$c$ [mm]	$f_b$ [N·mm <sup>-2</sup> ]	$V_{Rk,b} = V_{Rk.c,\parallel}$ [kN]
		$\geq 50$	4	2.0
			10	3.0

Related edge and spacing distance and group factor  $\alpha_g$

Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\perp} \geq$ [mm]	$\alpha_g$ [-]
	50	-	-		see Table C64	-	-
	50	50	1.0		see Table C64	50	1.0
	50	200	2.0		see Table C64	200	2.0
Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]	Configuration	$c \geq$ [mm]	$s_{\parallel}$ [mm]	$\alpha_g$ [-]
	50	50	1.0		see Table C64	50	1.0
	50	200	2.0		see Table C64	200	2.0

**Table C65: Displacements**


$h_{ef}$	<b>N</b>	$\delta_{N0}$	$\delta_{N\infty}$	<b>V</b>	$\delta_{V0}$	$\delta_{V\infty}$
[mm]	[kN]	[mm]	[mm]	[kN]	[mm]	[mm]
$\geq 50$	0.7	0.5	1.0	1.7	1.0	1.5


**ANNEX C30**  
**Performances hollow clay brick for ceiling**  
**Characteristic values of resistance under tension load**  
**Displacements**

This annex applies to the product described in the main body of the UK Technical Assessment.

**Brick type: Hollow clay brick for ceiling**

**Table C66: Description of brick**

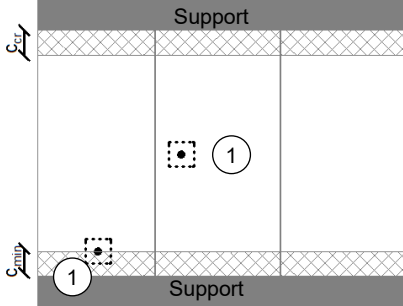Brick type		Ds-1.0	 Drawing of the brick see <b>Table B4</b>
Bulk density	$\rho \geq$ [kg·dm <sup>-3</sup> ]	1.0	
Strength		EN 15037-3. class R2	
Code		DIN 4160	
Producer		Fiedler Marktredwitz (D)	
Brick dimensions	[mm]	510 x 250 x 180	
Minimum ceiling thickness	$h_{min} \geq$ [mm]	$\geq 180$	

	① Single fastening Maximum one anchor per ceiling brick
--	--

**Table C67: Installation parameter for all anchor combinations (see Table B3)**

Anchor type		HIT-V M6 with HIT-SC 12x85
Edge distance	$c_{min} = c_{cr}$ [mm]	100 from support
Spacing $A_c$	$s_{min \parallel}$ [mm]	510
	$s_{min \perp} = s_{cr}$ [mm]	250

**Table C68: Group factor**

Group factor	$\alpha_{g,N \parallel} \alpha_{g,V \parallel} \alpha_{g,N \perp} \alpha_{g,V \perp}$ [-]	1
--------------	---	---

**Table C69: Characteristic tension resistance for all anchor combinations (see Table B3)**

Use category			w/w		d/d	
Service temperature range			Ta	Tb	Ta	Tb
Anchor type and size	$h_{ef}$ [mm]	Console load capacity [kN]	$N_{Rk,p} = N_{Rk,b}$ [kN]			
All anchor	$\geq 80$	3	1.5	1.5	1.5	1.5

**Table C70: Displacements**

$h_{ef}$	N	$\delta_{N0}$	$\delta_{N\infty}$
[mm]	[kN]	[mm]	[mm]
$\geq 80$	0.4	0.15	0.30



**British Board of Agrément,**  
1<sup>st</sup> Floor Building 3,  
Hatters Lane,  
Croxley Park  
Watford  
WD18 8YG