



APPLICATION:

**PVC Pipes with no Insulation**

ID:

**IS:SP-RW-M-01**

**INFORMATION:**

- Not to scale
- All units are in millimetres
- Tested according EN 1366-3
- [Approval ETA-10/0406](#)

**CFS-IS Intumescent Sealant**

REV:


DATE:

**01**


**10/2024**

**Fire Rating up to EI 120**

**Page 1/1**

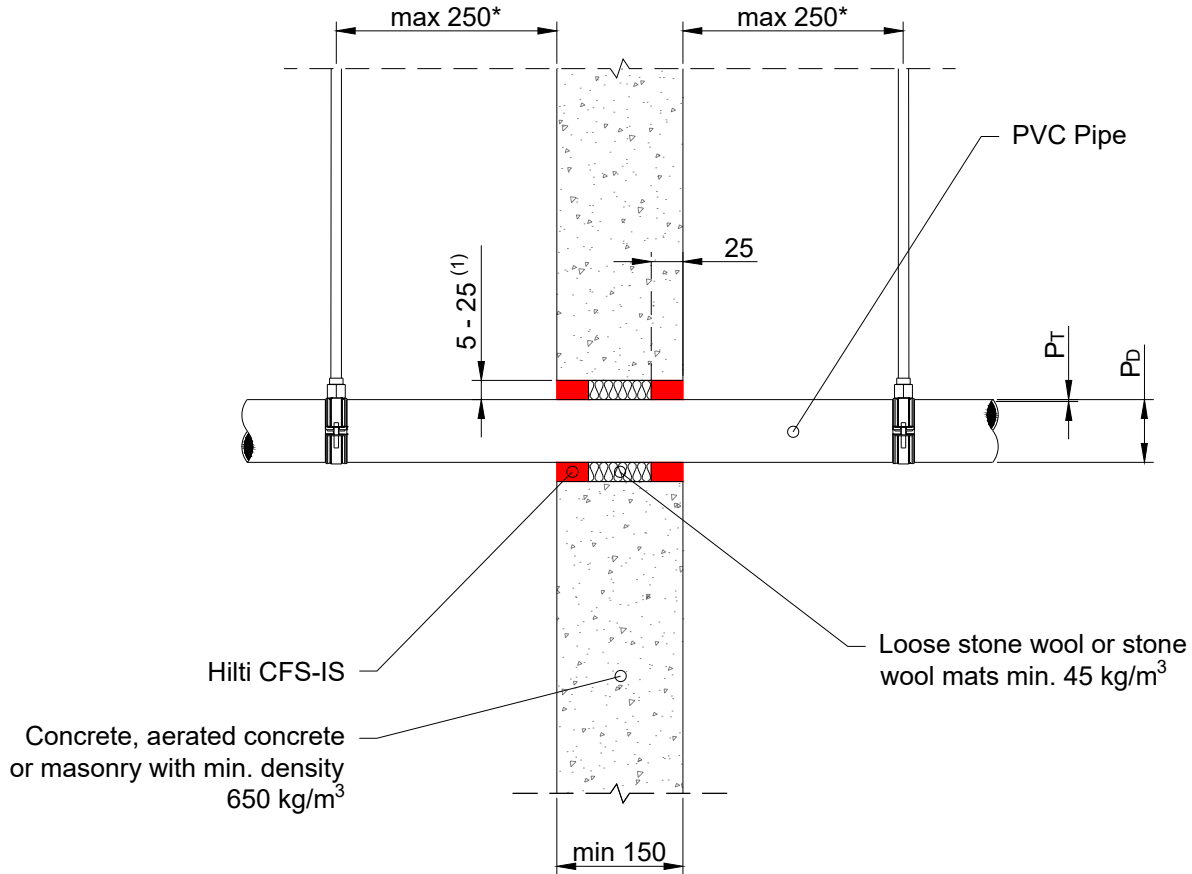

- (1) min. 5mm annulus provided
- min. 25mm on the opposite side

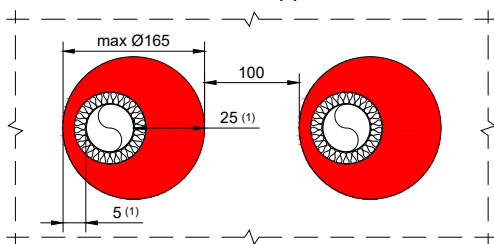

**PVC Pipes (EN1451-1)**

| $P_D \text{ } \varnothing$ | $P_T$         | Classification |
|----------------------------|---------------|----------------|
| $\geq 32 - 50$             | 1.8 / 2.2-6.4 | EI 180 U/U     |

Max opening size 150mm x 150mm or circular openings of equivalent area ( $\varnothing 165$ mm).

Min 100mm distance to other firestopping penetrations. Min. 200mm to other penetrations (e.g., doors, windows etc.)

\* First support and ancillary products should be capable of achieving the same fire performance as the seal and supporting structure.

\*\* Comprising of timber or steel studs. Wall construction itself has been classified according to EN 13501-2.

1. The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.  
 2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.  
 3. All installations should be carried out in accordance with Hilti's installation instructions and by competent & experienced installers using Hilti branded products.  
 4. All services are to be correctly and adequately supported to prevent collapse and distortion.